

Model 500XLFC

Water Pressure Reducing Valve with Flanged Connections

Application

Ideal for use where Lead-Free* valves are required. Designed for installation on potable water lines to reduce high inlet pressure to a lower outlet pressure. The high flow capacity makes this device most suitable for industrial water lines and commercial irrigation systems. The balanced piston design enables the regulator to react in a smooth and responsive manner to changes in system flow demand, while at the same time, providing protection from inlet pressure changes

Approvals

Meets the requirements of NSF/ANSI 61*
 *(0.25% MAX. WEIGHTED AVERAGE LEAD CONTENT)

Materials

Body & cover Low Lead Cast Bronze, ASTM B 806

Bell housing Cast Bronze, ASTM B 584

Stem & plunger Low Lead Cast Bronze, ASTM B 806

Internals Stainless steel, 300 Series
Elastomers EPDM (FDA approved)
Buna Nitrile (FDA approved)

Polymers Delrin™

Springs Oil tempered wire, ASTM A229,

Epoxy Coated

Cap gasket Natural Vulcanized Fibre Seat Stainless steel, 300 Series

Features

Sizes: 2", 21/2", 3"

Maximum working water pressure
Maximum working water temperature

Reduced pressure range (standard) End connections (flanged) 300 psi 140° F 25 psi te

25 psi to 75 psi ANSI Class 125







Options

(Suffixes can be combined)

 $\hfill \hfill \hfill$

range, field set

☐ FSC - with cast iron "Y" type flanged strainer, fusion

epoxy coated, inside and out (2-1/2" & 3" only)

 \square SC - sealed cage for use in pit or vault

SW - made for salt water service□ HR - spring range is 75-125 psi, field set

□ HLR - spring range is 10-125 psi, field set

☐ HTSTSC- high temperature application, up to 180° F
☐ LPV - high temperature application, up to 180° F,

high temperature application, up to 180° F, spring range is 10-35 psi, factory set at 20 psi

□ LPC - spring range is 10-35 psi, factory set at 20 psi□ BP - tapped and plugged for 3/4" bypass connection


□ P - tapped and plugged for gauge□ G - tapped and plugged with gauge

☐ TBP - valve stem features integral thermal by-pass

check valve (applies to 3" size only)"

Accessories

☐ Repair kit (rubber only)



Dimensions & Weights (do not include pkg.)

SIZE		CONNECTIONS	DIMENSIONS (approximate)								WEIGHT	
			A		В		С		D		WEIGHT	
in.	mm		in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg.
2	50	FLANGED	10 3/8	263	15	381	3	76	6 1/2	165	30	13.5
2 1/2	65	FLANGED	10 3/8	263	15	381	3 1/2	89	8	203	30	13.5
3	80	FLANGED	11	279	17 3/4	451	3 3/4	95	8	203	50	22.5

Zurn Industries, LLC | Wilkins


1747 Commerce Way, Paso Robles, CA U.S.A. 93446 Ph. 855-663-9876, Fax 805-238-5766

In Canada | Zurn Industries Limited

3544 Nashua Drive, Mississauga, Ontario L4V 1L2 Ph. 905-405-8272, Fax 905-405-1292


Rev. D Date: 5/18 Document No. REG-500XLFC Product No. Model 500XLFC

MODEL 500XLFC 2" THRU 3" (STANDARD & METRIC)

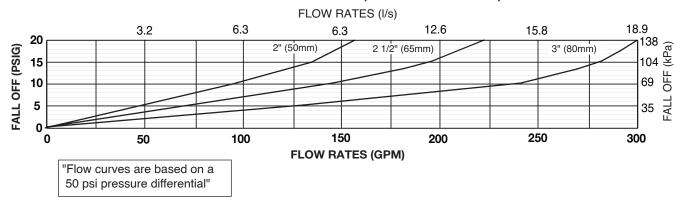

Typical Installation

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted in accordance with the manufacturer's instructions and the latest edition of the Uniform Plumbing Code. The assembly shall be installed with sufficient side clearance for testing and maintenance. The Model 500XLFC may be installed in any position. If installed in a pit or vault, or indoor application, specify the "SC" sealed cage option. Multiple installations are recommended for wide demand variations or where the desired pressure reduction is more than 4 to 1 (i.e.: 200 psi inlet reduced to 50 psi outlet). **CAUTION:** Anytime a reducing valve is adjusted, a pressure gauge must be used downstream to verify correct pressure setting. Do not bottom adjustment bolt on bell housing.

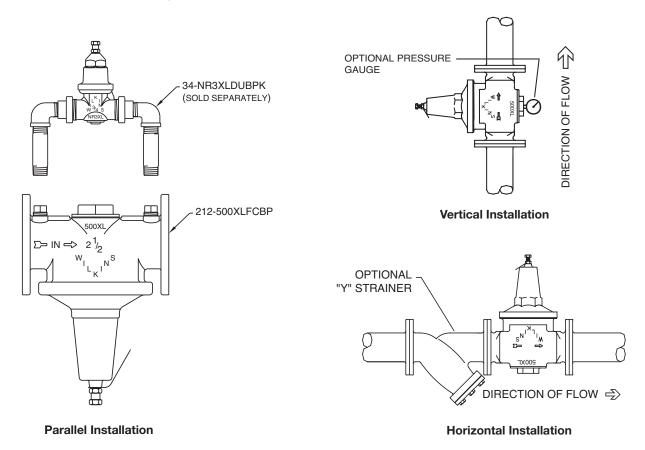

Specifications

The Pressure Reducing Valve shall be certified to NSF/ANSI 61, consist of a bronze body and bell housing with flanged connections, shall have a separate access cover for the plunger and shall have a bolt to adjust the downstream pressure. The assembly shall be of the balanced piston design and shall reduce pressure in both flow and no-flow conditions. The bronze bell housing and access cap shall be threaded to the body and shall not require the use of ferrous screws. The Pressure Reducing Valve shall be a ZURN WILKINS Model 500XLFC.